

State of Tennessee
Department of Environment and Conservation
Division of Water Resources
William R. Snodgrass - Tennessee Tower
312 Rosa L. Parks Avenue, 11th Floor
Nashville, Tennessee 37243-1102

MR. JERRY KERLEY
CITY OF CROSSVILLE - MEADOW PARK WTP
963 CITY LAKE ROAD
CROSSVILLE, TN 38572
e-copy: jerry.kerley@crossvilletn.gov

**Filter Backwash and Sedimentation Basin Washwater From Water Treatment Plants (WTP)
Notice of Coverage Fact Sheet**

The Division of Water Resources received from your company a notice of intent (NOI) to be covered under the General NPDES Permit for discharges of Filter Backwash and Sedimentation Basin Washwater from Water Treatment Plants (WTP). The new WTP became effective on August 21, 2015, and expires on August 19, 2020. **We have recorded your facility's information and are hereby notifying you that your facility is covered under this general permit.**

Enclosed with this fact sheet you will find a notice of coverage with the permit tracking number, facility's name, address and receiving stream information that apply to your facility. In order to receive a copy of the WTP permit we ask that you visit our web site located at: <http://tn.gov/environment/permits/filtwash.shtml>. We will provide you with a printed copy of the WTP only upon your request.


At our web site, you will be able to download general requirements, as well as permit rationale, notice of determination and links to relevant web sites. If you do not have access to the Internet, or have additional questions, please contact us at 1-888-891-TDEC. Below is a summary of effluent limits that apply to regulated WTP in general.

| EFFLUENT CHARACTERISTIC | DAILY MAX. CONC. (MG/L) | SAMPLE TYPE | MONITORING FREQUENCY |
|------------------------------|-------------------------|---------------|----------------------|
| Flow | Report Flow Rate | Instantaneous | Monthly |
| Total Suspended Solids (TSS) | 40 | Grab | Monthly |
| Settleable Solids | 0.5 (mL/L) | Grab | Monthly |
| pH | 6.5 – 9.0 | Grab | Monthly |
| Iron (total) | 2.0 | Grab | Monthly |
| Aluminum (total) | 0.75 | Grab | Monthly |
| Chlorine (total residual) | 0.019 | Grab | Monthly |

Sincerely,



Vojin Janjic
Manager, Water-Based Systems

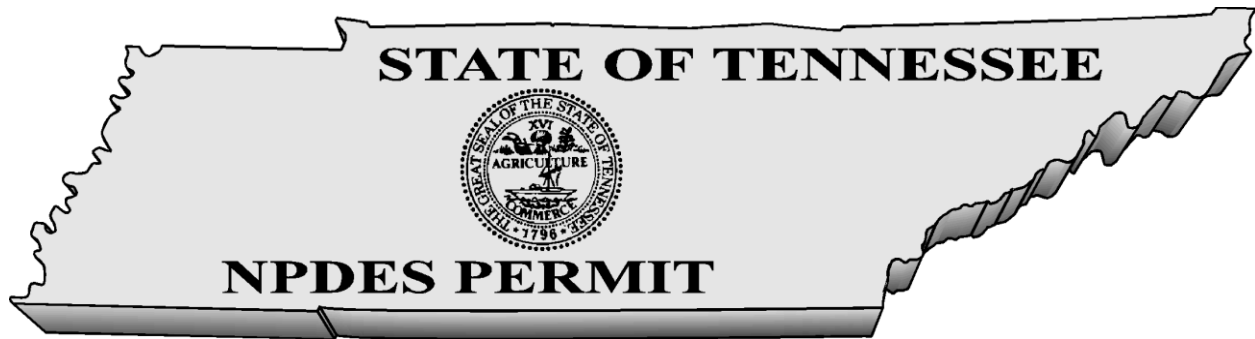

No. TN0077909

Notice of Coverage under the General NPDES Permit for Discharges of
**FILTER BACKWASH AND SEDIMENTATION BASIN
WASHWATER FROM WATER TREATMENT PLANTS**

Issued By

State of Tennessee
Department of Environment and Conservation
Division of Water Resources
William R. Snodgrass - Tennessee Tower
312 Rosa L. Parks Avenue, 11th Floor
Nashville, Tennessee 37243-1102

Under authority of the Tennessee Water Quality Control Act of 1977 (T.C.A. 69-3-101 et seq.) and the delegation of authority from the United States Environmental Protection Agency under the Federal Water Pollution Control Act, as amended by the Clean Water Act of 1977 (33 U.S.C. 1251, et seq.):

Discharger: **City of Crossville - Meadow Park WTP**
is authorized to discharge: **filter backwash and/or sedimentation basin washwater from water treatment plants**
from a facility located: **in Crossville, Cumberland County, Tennessee**
to receiving waters named: **Meadow Park Lake**

in accordance with effluent limitations, monitoring requirements and other conditions set forth herein.

Coverage under this general permit shall become effective on **October 15, 2015**

and shall expire on **August 19, 2020**

Issuance date: **October 15, 2015**